

Mains Powered

# Ei3030 Multi-Sensor Fire Alarm & Carbon Monoxide

## Instruction Manual











Read and retain carefully for as long as the product is being used. It contains vital information on the operation and installation of your Alarm. The manual should be regarded as part of the product.

If you are just installing the unit, the manual **MUST** be given to the householder. The manual is to be given to any subsequent user.



## Symbol Glossary

The symbols on this page are used in accordance with EN 62368-1, IEC 60417, ISO 7000 and other applicable standards. They are used to convey information on the safe and effective use of our devices. These symbols may be used on the device itself, on its packaging or in associated documentation.

Symbol	Description	Symbol	Description
	<p><b>Class II Equipment</b> A Class II (class 2) or double insulated electrical device is designed in such a way that it does NOT require a safety connection to electrical earth (ground).</p>		<p><b>CE mark</b> This indicates that this product conforms with the relevant EN standards for products sold within the European Economic Area (EEA). The CE marking is also found on products sold outside the EEA that are manufactured in, or designed to be sold in, the EEA.</p>
	<p><b>Protective earth</b> This identifies protective earthing terminals.</p>		<p><b>UKCA mark</b> This indicates that this product conforms with the relevant standards for products sold within the United Kingdom (UK). The UKCA marking is also found on products sold outside the UK that are designed to be sold in the UK.</p>
	<p><b>End of life</b> This indicates the date after which the device should be replaced.</p>		<p><b>The Green Dot</b> This is a European trademark that indicates that the manufacturer has contributed financially to the recycling of packaging in Europe.</p>
	<p><b>Crossed Paint Brush</b> This indicates that the device must not be painted.</p>		<p><b>Mobius Loop</b> This indicates that the packaging of this product can be recycled.</p>
	<p><b>Screwdriver</b> This indicates the location of the releasing latch used to detach the Alarm from its mounting plate.</p>		
	<p><b>WEEE symbol</b> Indicates that the device must be taken to a recycling point when it has reached its end of life.</p>		

## Contents

<b>Installer Guide</b>	<b>5</b>
<b>1. Introduction</b>	<b>5</b>
1.1 Overview	7
1.2 Technical Specifications	8
<b>2. Installation</b>	<b>10</b>
2.1 Important Safety Instructions	11
2.2 Where to locate the Alarm?	12
2.3 Where in the room?	16
2.4 Unsuitable locations	18
2.5 Mounting and wiring	19
2.6 Interconnecting Alarms	23
2.7 Removing the Alarm	26

<b>User Guide</b>	<b>27</b>
<b>3. What is Carbon Monoxide?</b>	<b>27</b>
3.1 Symptoms of CO poisoning	29
3.2 How to protect your family against CO	30
3.3 How does your Alarm work	31
<b>4. Testing</b>	<b>36</b>
4.1 Testing and maintaining your Alarm	37
4.2 Cleaning your Alarm	39
<b>5. What to do in case of Fire alarm</b>	<b>41</b>
<b>6. What to do in case of CO alarm</b>	<b>43</b>
<b>7. Indicator Summary Tables &amp; Troubleshooting</b>	<b>45</b>
<b>8. Limitations of Fire and CO Alarms</b>	<b>54</b>
<b>9. Important safeguards</b>	<b>57</b>
<b>10. Service and Guarantee</b>	<b>59</b>
10.1 Getting your Alarm serviced	60
10.2 Guarantee	60

# Installer Guide

# 1

## Introduction

The Ei3030 is a Multi-Sensor Fire & Carbon Monoxide Alarm, detecting smoke, heat and carbon monoxide. It contains a proven optical sensor, with automatic dust compensation, for smouldering fires, as well as an independent fast acting Class A1 Thermistor sensor to detect dangerous levels of heat and an electrochemical CO sensor to detect the presence of abnormal levels of Carbon Monoxide. The combination of Smoke, Heat and CO detection makes it a very versatile Alarm for most rooms in your house.

Up to 12 Alarms can be interconnected so that if one senses fire and/or CO, all Alarms sound. It can be a hardwired interconnection, a wireless interconnection or a mixture of both (for the wireless option an Ei3000MRF SmartLINK module needs to be added to each Alarm – sold separately).


The Ei3000 series is supplied with a mounting plate that allows very quick and simple installation of the Alarm. The mains and battery power is automatically connected as the Alarm slides onto the mounting plate.

Each Alarm comes with built-in rechargeable backup batteries to power the Alarm in the event of a mains failure.

### **AudioLINK+**

The Ei3000 series Alarms are AudioLINK+ enabled. This feature allows the user to download information from the Alarm through the use of a smart phone App. For more information on using this feature, please refer to the relevant section on [www.aico.co.uk](http://www.aico.co.uk).

## 1.1 Overview

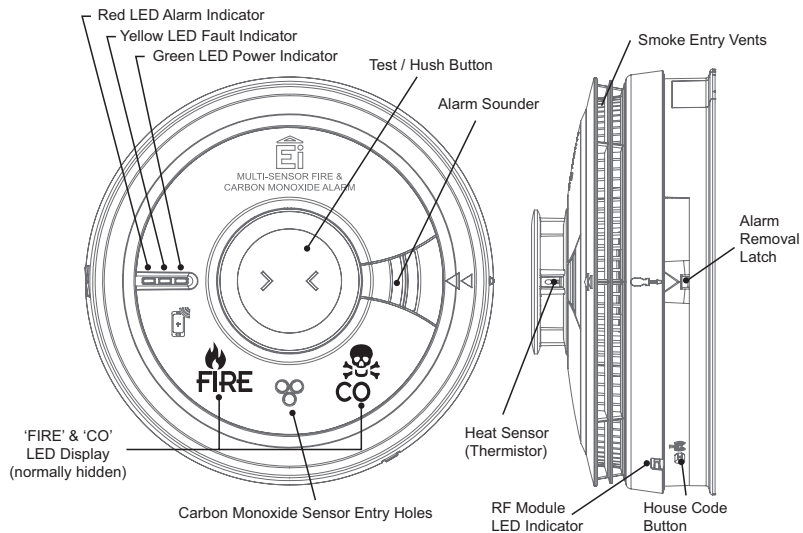

## 1.2 Technical Specifications

<b>Optical Sensor</b>	Optical Photoelectric
<b>Heat Sensor</b>	Thermistor Class A1 detection – Alarm is triggered at 58°C
<b>Carbon Monoxide Sensor</b>	Electrochemical
<b>Power Supply</b>	100-250V AC, 50Hz, 0.25W
<b>Battery Backup</b>	Built-in 10-year rechargeable Vanadium Pentoxide Lithium cells. Fully charged, the battery will provide up to 6 months (without module fitted) or 3 months (with module fitted) back-up without mains power
<b>Alarm Sounder</b>	Piezoelectric Alarm
<b>Alarm Sound Level</b>	85dB(A) at 3 meters (min)
<b>Memory Feature</b>	Indicates that the Alarm has previously detected fire and or dangerous levels of CO
<b>Operational Life</b>	10 years
<b>Self Test</b>	Sensors, battery and electronics are automatically tested periodically
<b>Test/Hush button</b>	Checks sensors, electronics, display, interconnection and sounder. If the unit is in alarm when pressed, it silences the alarm for 10min (if alarming due to heat or smoke), 4 minutes (if alarming due to <150ppm CO)
<b>AudioLINK+</b>	Enabled



<b>Visual indicators</b>	Green LED – Power supply, Test    Yellow LED – Fault, EOL Red LED – memory, pre-alarm or alarm (if coincides with alarm sounding)
<b>Display</b>	Indicates FIRE or CO
<b>Interconnection</b>	Up to 12 units can be interconnected via a hardwired or wireless system (using optional Ei3000MRF SmartLINK module)
<b>Fixings</b>	Supplied with Easi-fit anti-tamper mounting plate with integral terminal block and wiring cover, includes screws and wall plugs
<b>Operating &amp; Storage Temperature</b>	-10°C to +40°C*
<b>Humidity Range</b>	15% to 95% RH (non-condensing)
<b>Plastic Material</b>	UL94V-0 flame retardant rated
<b>Dimensions</b>	Product: - Ø150mm x 66mm    Package - 155 x 155 x 70mm
<b>Weight</b>	412g (including packaging)
<b>Warranty</b>	5 year (limited)
<b>Approvals</b>	KM86596, KM522831, KM83678, EN14604:2005+AC 2008, EN50291-1:2018 BS5446-2:2003

\* Temperature and Humidity conditions are for normal operation and storage. Units will function outside these ranges as required by the specific product Standards. Extended exposure to conditions outside these ranges can reduce product life. For advice on prolonged operation outside these ranges consult the manufacturer.

# 2

## Installation

## 2.1 Important Safety Instructions

**WARNING:** Mains operated Alarms must be installed and interconnected by a qualified electrician in accordance with the local appropriate Regulations for Electrical Installations. Failure to install this Alarm correctly may expose the user to shock or fire hazards and damage the product.

The Alarm is designed to be permanently mounted, using its own built-in terminal block to connect it to the mains power supply. The mounting plate can be screwed directly to the ceiling. Alternatively, it can be screwed to a standard junction box (BS 4662 single gang accessory box). It requires a typical current of 3mA. The Alarm must not be exposed to dripping or splashing. There are important markings on the underside of the Alarm.

**WARNING:** The installation of main operated Heat Alarms should comply with BS 7671.

**WARNING:** It is a requirement that CO Alarms must be installed by a competent person.

**ATTENTION:** Alternative Energy Sources - (Wind, Solar, UPS etc.)

This product is designed to be connected to a Pure or True Sine Wave 230V AC supply. If connecting to a power source that utilises an inverter, e.g. PV solar panel, the Total Harmonic Distortion (THD) must be less than 5%. If in doubt please check with the manufacturer of the inverter. This also applies to battery powered UPS (Uninterruptible Power Supply) inverters.

**ATTENTION:** Light Dimmer Circuits - The Alarms must not be powered from a light dimmer circuit.

**ATTENTION:** Do **not** install Alarms in new or renovated buildings until all work is completed.

**ATTENTION:** The Alarm must **not** be connected when the house wiring insulation is being checked with high voltages. i.e. Do **not** use a high voltage insulation tester on the Alarm.

**ATTENTION:** The Alarm must be continuously powered 24 hours a day so it is important that it is not on a circuit that can be turned off by a switch.

**ATTENTION: (UK)** BS 5839-6:2019 gives the following recommendations regarding the mains supply to be used in a Grade D system. The power supply for the Alarms should be derived from the public electricity supply to the dwelling. The mains supply to the Alarms should take the form of either:

(a) an independent circuit at the dwelling's main distribution board, in which case no other electrical equipment should be connected to this circuit (other than a the supply to a dedicated social alarm control unit); or

(b) a separately electrically protected, regularly used local lighting circuit.

(See BS 5839-6:2019 for further information).

**WARNING:** An all-pole mains switch shall be incorporated in the electrical installation of the building.

**WARNING:** Batteries (battery pack or batteries installed) shall not be exposed to excessive heat such as sunshine, fire or the like.

## 2.2 Where to locate the Alarm

### Fire Alarms

The Ei3030 contains 3 sensors for smoke, heat and CO detection. It is a versatile Alarm that can be placed in most rooms of the house, with the exception of a Shower/Bathroom. Care must also be taken if installing in a kitchen/garage to avoid false alarms due to cooking fumes and contaminants. A Heat Alarm or combined Heat and CO Alarm may be more suitable for these areas.

The main reason for fitting Multi-Sensor Alarms in dwellings is to ensure that when there is a fire and/or dangerous levels of CO, sufficient early warning is given so that everybody can escape safely. This means that the Alarms should ideally be located near all potential sources of fire and CO and that the alarm should be heard throughout the house – particularly in the bedrooms.

It is also important that nuisance/false alarms are minimised to ensure the Alarms are not disabled or ignored.

A single Alarm will give some protection if it is properly installed, but most homes will require two or more to ensure that a reliable early warning is given. For recommended protection you should put individual Alarms in all rooms where fire and/or dangerous levels of CO is most likely to break out (apart from the kitchen and bathroom).

BS 5839-6:2019 gives guidance on:

- how many Alarms to install
- what type of Alarm to use
- where to position Alarms

The above points will depend on the type of dwelling to be protected and the level of fire risk.

Fire Risk Assessment

The 'Grade' and 'Category' of system that should be installed depends on the fire risk. It is therefore recommended that a Fire Risk Assessment is undertaken. The Risk Assessment would be based on a combination of probabilities:

- fire occurring
- injury or death to occupant
- system operating correctly with a fire
- early detection and warning to occupants in the event of a fire

The greater the risks, the more comprehensive and reliable systems needs to be.

LD (Life protection in Dwellings) Systems define the level of fire protection required for households, depending on the fire risk and regulations. Aico/Ei Electronics recommends that an LD1 system be installed for optimum protection.

Please see following pages for detailed information.

### **CO Alarms**

For CO detection, the Ei3030 should be installed in every room containing a fuel burning appliance.

For more detailed information, please refer to EN50292: 2023.

## UK Requirements (BS 5839-6:2019)

### LD1 OPTIMUM PROTECTION

for dwellings where occupants may be at high risk (e.g. elderly)

**Optimum Protection LD1:** As LD2, but in addition Smoke or Heat Alarms should be located in all rooms and other areas of the dwelling. (apart from toilets or bathroom)

*Interconnect all Alarms*

### LD2 BASIC PROTECTION

for new or materially altered dwellings or existing dwellings with poor structural fire precautions

**Basic Protection LD2:** Smoke or Heat Alarms in all rooms or areas that present a high fire risk to occupants. (apart from toilets or bathroom)

*Interconnect all Alarms*




**Multi-Sensor or Smoke Alarms** located:

- on each storey
- every 7.5 m of hallways and escape routes
- within 3m of all bedroom doors (apart from toilets & bathrooms ☒)




**Heat Alarms** located in:


- each Kitchen (Heat Alarms must be within 5.3m of potential fire sources)

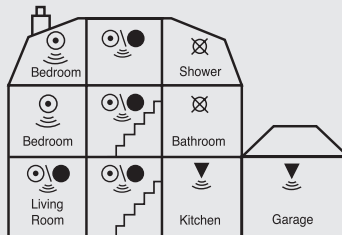

Multi Storey Dwelling LD1

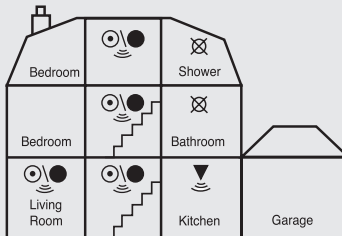

Multi Storey Dwelling LD2



## 2.3 Where in the room?

The locations must comply with applicable building regulations

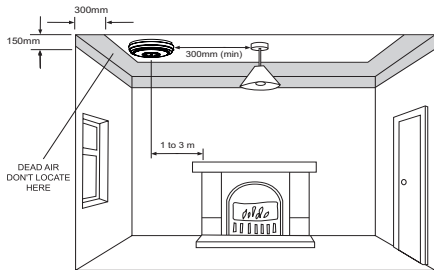


Fig.1

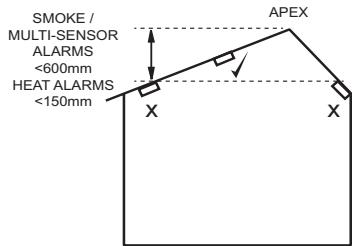


Fig.2

### - Ceiling Mounting

Hot smoke and gases rise and spread out, so a central ceiling position is the preferred location. The air is "dead" and does not move in corners, therefore Alarms must be mounted away from corners.

Fit the Alarm:

- At least 300mm away from walls (see Figure 1).
- At least 300mm from any light fitting or decorative object which might obstruct smoke / heat / CO entering the Alarm.



### - **Sloping Ceiling**

With a sloping or peaked ceiling, for optimum smoke detection, install the Alarm within 600mm of the peak (measured vertically). For optimum heat detection, install the Alarm within 150mm. If the height of the peak is inferior to these measurements, then the ceiling is regarded as being flat. (see Figure 2).

### - **In a room WITH a fuel burning appliance**

- The Alarm should be at a horizontal distance of between 1m and 3m from the potential CO source.
- If there is a partition in the room, the Alarm should be located on the same side of the partition as the potential source.

**The Ei3030 is not suited for wall mounting.**


## 2.4 Unsuitable locations

Do not place the Alarm in any of the following areas:

- In a bathroom or other areas where the Alarm may be exposed to water splashes, dripping or condensation (e.g. above an electric kettle).
- In very high or awkward areas where it may be difficult to reach the Alarm (for testing, hushing etc.) or fit the screwdriver to release the Alarm from its mounting plate.
- Next to or directly above heaters or air conditioning vents, doors, windows, extractor fans or anywhere that it would be affected by draughts.
- Directly above a sink or cooker.
- In an area where the temperature could drop below  $-10^{\circ}\text{C}$  or rise above  $40^{\circ}\text{C}$ .
- Outside the building.
- In an enclosed space (e.g. in or below a cupboard).
- In a damp or humid area.
- Where it would be obstructed, e.g. by curtains or furniture.
- Where dirt or dust could block the sensor.
- Near paint, thinners, solvent fumes or air fresheners.
- Locate the Alarm at least 1.5m and route wiring at least 1m away from fluorescent light fittings as electrical "noise" and/or flickering may affect the Alarm. Do not wire into the same circuit as fluorescent lights or dimmers.
- Locate the Alarm at least 1m from dimmer controlled lights and wiring as some dimmers can cause interference.


## 2.5 Mounting and wiring

**WARNING:** to prevent injury, this apparatus must be securely attached to the ceiling or wall in accordance with the installation instructions.

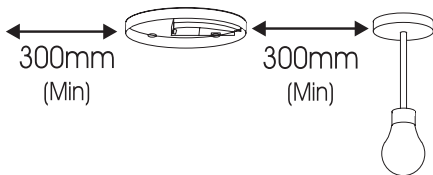

Foam ceiling gasket  
(must be in place)

Fig.3

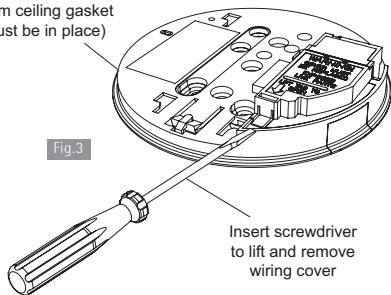

Insert screwdriver  
to lift and remove  
wiring cover

1. Select a location complying with the advice in previous sections.

2. Disconnect the AC mains supply from the circuit that is going to be used.

3. Lift off the wiring cover as shown in Figure 3.

**L: Live** - connect to the house wires coloured brown or marked L.

**N: Neutral** - connect to the house wires coloured blue or marked N.

**IC: Interconnect** - see figures 5 and 6 and further information in Section 2.6.



**WARNING:** *Wiring must be installed in compliance with local regulations.*

**WARNING:** Mixing (or poorly terminating) the Live and Neutral connections when interconnecting Alarms may damage all the Alarms - ensure that the same colours are used throughout the premises for Live, Neutral and Interconnect wires.

We strongly recommend that you check for the following **before connecting the Alarm:**

- check for Live and Neutral using a two probe tester.
- check for Live using a neon tester.
- check that the Interconnect wire is NOT connected to Live, Neutral or Earth. **Do not use an Earth wire for the Interconnect line.**

**Note:** The Alarm does not need to be earthed. However the terminal marked  $\oplus$  is provided for the convenience of the installer so that any copper Earth wire or cable coloured green and yellow, can be safely terminated.

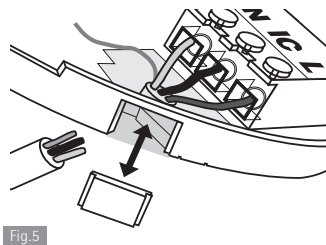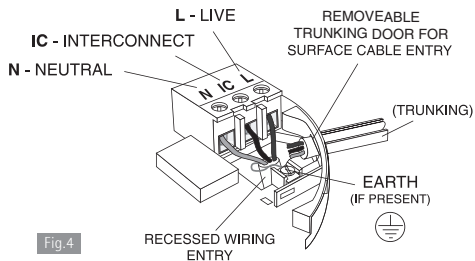

To interconnect Alarms connect all the IC terminals together as shown in Figure 8 (see "Interconnecting Alarms" section).

**4.** If the mains wires are recessed, bring the wires through the rear hole in the mounting plate as shown in Figure 4.

If the mains wires are being brought along the surface:

(a) position the mounting plate so the cable trunking is as shown in Figure 4.

(b) the mounting plate has a removable section, take it out to interface directly with 25mm trunking as shown in Figure 5. If interfacing to 16mm trunking carefully cut around the marked section, leaving the top intact and replace the section. (If you are not using surface wiring, the removable section must be left in place for electrical safety reasons).

There are two other positions which are also suitable for the surface wiring to enter (and exit) the Alarm, one next to the removable section and another directly opposite.

**5.** Carefully align the mounting plate and screw into place. Connect the wires to the terminal block. With recessed wiring, ensure the rear gasket seals around the edge of the hole in the ceiling or wall. This is to prevent air draughts affecting the CO/heat entering the Alarm. If the hole is too large or the Alarm does not seal it, it should be sealed with silicone rubber or equivalent.

**6.** Replace the wiring cover and carefully line up the Alarm on the mounting plate and slide on (see Figure 6).

**7.** Connect the mains power to the Alarm circuit. Check the green light on the front of the Alarm is on.

**8.** Press and hold the test/hush button for 10 seconds (see Figure 7). The alarm will sound. Check that any interconnected Alarms also sound within this period. The test/hush button sounds the local alarm and

on release this alarm stops immediately, and all the interconnected Alarms can then be heard in the distance as they will continue to sound for a further 3 seconds. **Note: On initial press the Ei3030 will emit the fire sound pattern. On second press the Ei3030 will emit the CO sound pattern.**

9. Attach the 'fuse board label' provided on or near the distribution board and write in date installed and the number of Alarms on the circuit.

10. Ensure the Alarm operates correctly - see **TESTING and MAINTAINING YOUR ALARM** section.

Fig.6

### Slide on the Alarm


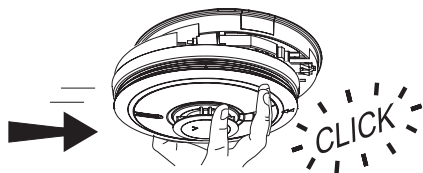


Fig.7

### Test Alarms

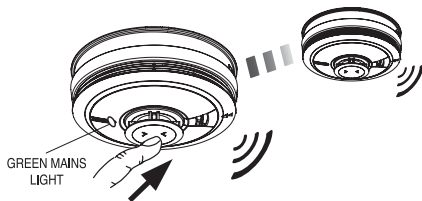

## 2.6 Interconnecting Alarms

With interconnected Alarms, when one device detects Fire or CO, all will sound. All Alarms will sound but only Alarms detecting the emergency event will be flashing their red LED alarm indicator.

Any Ei3000 series Alarms can be hardwire interconnected with other Aico mains Alarms such as the Ei140e series.

**Note:** A maximum of 12 devices can be interconnected in an Aico Alarm system.

If you wish to connect more than 12 devices, contact the Aico Technical Department on 01691 664100.

**WARNING:** Do not hardwire interconnect mains powered Alarms with low voltage or battery powered Aico Alarms/devices or any other type of Alarm produced by another manufacturer. Doing so may damage the Alarms and could result in a shock or fire hazard.

Systems using more than 3 or 4 Alarms must be very carefully planned to ensure nuisance alarms are not excessive. e.g. from cooking fumes or steam. The following is suggested:

- In an RF system an Aico Alarm Controller (Ei450) should be incorporated and be readily accessible to all occupants so that the source of an alarm can be quickly identified. This is especially important when both Fire and CO Alarms are used in the same system as the occupant will need to open all windows and doors if it is a CO incident but do the opposite to slow down a fire.

Make electrical connections as shown in Figure 8.

Wiring must be installed in compliance with local regulations.

In the UK it is recommended that the following coloured cores are used (for example with triple flat 6243YH cable).

**230V supply** : Brown

**Neutral**: Grey sleeved blue at terminations

**Interconnect** : Black

The interconnect wire (minimum 0.75mm<sup>2</sup> cable) must be treated as if it was Live. It should be insulated and sheathed.

A maximum of 250 metres of wire can be used (maximum resistance between detectors 50 Ohms). Alarms should be interconnected only within the confines of a single family living unit. If they are connected between different units, there may be excessive nuisance alarms. Everybody may not be aware that they are being tested or that it is a nuisance alarm caused by cooking etc.

The Alarm can also be RF interconnected to other RF Alarms and devices by installing an Ei3000MRF SmartLINK Module. See the User manual for the Ei3000MRF for further details on RF interconnection. For maximum RF signal strength, orientate all mounting plates in the same direction to ensure the antennas of the RF modules are all facing the same way as shown in figure 9.

It is also equipped to work in a hybrid system (combination of hard-wired and RF interconnected Alarms and devices).


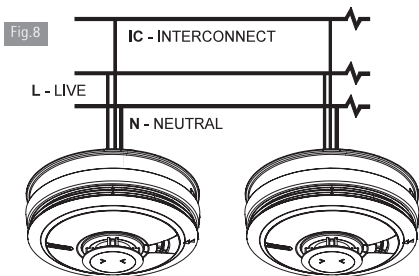




Fig.9

**Orientate all  
mounting plates  
in the same  
direction**




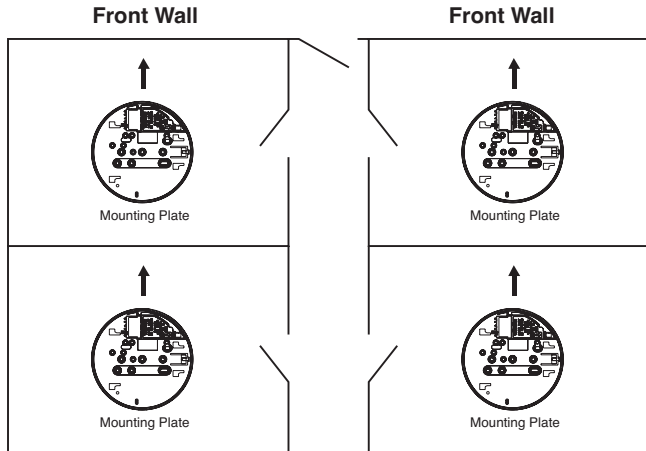


Please note in a hybrid system containing Smoke/Heat/CO Alarms we recommend using an Ei3000 Series Alarm as the hybrid link to the RF section of the system.

Ensure the Alarms operate correctly - see **TESTING YOUR ALARM** in the user section.

## 2.7 Removing the Alarm

**\* Disconnect mains before removal \***

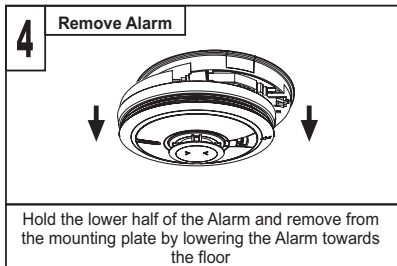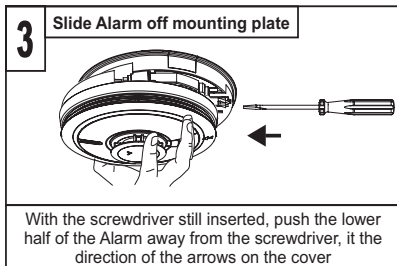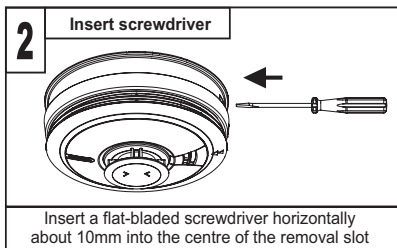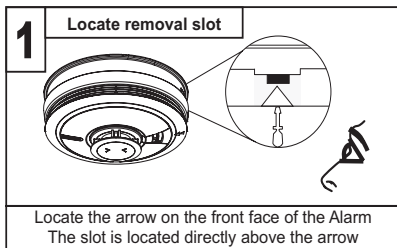

# User Guide

## 3

### What is Carbon Monoxide?

Many people are killed each year, and many more suffer ill health from Carbon Monoxide (CO) poisoning. CO is an invisible, odourless, tasteless and extremely toxic gas. It is produced by appliances and vehicles burning fuels, such as coal, oil, natural/bottled gas, paraffin, wood, petrol, diesel, charcoal etc. CO is absorbed by red blood cells in the lungs in preference to oxygen - this results in rapid damage to the heart and brain from oxygen starvation.

High levels of CO in a house can be caused by:

- Incorrectly or poorly installed fuel-burning appliances.
- Blocked or cracked chimneys/flues.
- Blocked vents or draught-proofing which makes areas with fuel burning appliances or fireplaces airtight.
- Engines of cars, lawnmowers etc. left running in confined spaces.
- Portable paraffin or gas heaters in badly ventilated rooms.

Most people know that high levels of CO are harmful, however the period of exposure is also important.

A low level for a long period (e.g. 150 ppm for 90 minutes) can cause the same symptoms (a slight headache) as a high level of CO for a short period (e.g. 350 ppm CO for 30 minutes). Table A shows how exposure to different concentrations of CO generally affects people.

Many cases of reported Carbon Monoxide poisoning indicate that while victims are aware they are not well, they become so disorientated they are unable to save themselves by either leaving the building or calling for assistance. Young children and household pets may be the first affected.

### 3.1 Symptoms of CO poisoning

Table A

Concentration of CO in Air ppm	Inhalation Time (approx) and Symptoms Developed
35	The maximum allowable concentration for continuous exposure in any 8 hour period according to OSHA *.
150	Slight headache after 1.5 hours.
200	Slight headache, fatigue, dizziness, nausea after 2-3 hours.
400	Frontal headaches within 1-2 hours, life threatening after 3 hours, also maximum parts per million in flue gas (on an air free basis) according to US Environmental Protection Agency.
800	Dizziness, nausea and convulsions within 45 minutes. Unconsciousness within 2 hours. Death within 2-3 hours.
1,600	Headache, dizziness and nausea within 20 minutes. Death within 1 hour.
3,200	Headache, dizziness and nausea within 5-10 minutes. Death within 25-30 minutes.
6,400	Headache, dizziness and nausea within 1-2 minutes. Death within 10-15 minutes.
12,800	Death within 1-3 minutes.

▲ ppm = parts per million

\*OSHA Occupational Safety and Health Association

### 3.2 How to protect your family against CO

Follow these guidelines to reduce the risk of Carbon Monoxide poisoning.

(1) Know and look out for tell-tale signs that Carbon Monoxide may be present.

These include:

- The Alarm warning of abnormal levels of CO.
  - Staining, sooting or discolouration on or around appliances.
  - A pilot light frequently going out.
  - A strange smell when an appliance is operating.
  - A naked gas flame which is yellow or orange, instead of the normal blue.
  - Family members (including pets) exhibiting the "flu-like" symptoms of CO poisoning described above. If any of these signs are present get the appliance checked out by an expert before further use. If family members are ill get medical help.
- (2) Choose all appliances and vehicles which burn fossil fuels such as coal, oil, natural/bottled gas, paraffin, wood, petrol, diesel, charcoal etc. with care and have them professionally installed and regularly maintained.
- (3) These appliances must "breathe in" air to burn the fuel properly. Know where the air comes from and ensure vents/air bricks etc. remain unobstructed (particularly after building work).
- (4) The appliances must also "breathe out" the waste gases (including the CO) – usually through a flue or chimney. Ensure chimneys and flues are not blocked or leaking, and get them checked every year. Check for excessive rust or cracks on appliances and pipe work.
- (5) Never leave your car, motor bike or lawnmower engine running in the garage with the garage door closed. Never leave the door from the house to the garage open if the car is running.
- (6) Never adjust your own gas pilot lights.














- (7) Never use a gas cooker or a barbecue for home heating.
- (8) Children should be warned of the dangers of CO poisoning and instructed never to touch, or interfere with the Alarm. Do not allow small children to press the test/hush button as they could be subjected to excessive noise when the Alarm sounds.
- (9) Leaving windows or doors slightly open (even a few inches) will significantly reduce the risk of high levels of CO occurring. The high levels of draught-proofing in modern houses reduces ventilation and can allow dangerous gases to build up.
- (10) Install Alarms in all the areas recommended in this booklet.
- (11) Recognise that CO poisoning may be the cause when family members suffer from “flu-like” symptoms when at home but feel better when they are away for extended periods.

**IMPORTANT:** The Installation of the Alarm should not be used as a substitute for proper installation, use and maintenance of fuel burning appliances including appropriate ventilation and exhaust systems.



### 3.3 How does your Alarm work?

When the Alarm detects Fire and/or abnormal levels of CO, the red LED starts to flash and the alarm will sound. The Alarm will also trigger all interconnected Alarms to sound, so that the occupier is alerted even if they are in a different room to the emergency event.

The standard Aico Fire alarm pattern is a continuous rapid pulsing sound type, while the distinctive Carbon Monoxide alarm pattern is a repeating cycle of 3 slower sound pulses followed by a pause. On the Ei3030, the LED display will indicate if Fire or CO is detected. The flash rate of the red LED indicator is dependent on the alarm event type, and in the case of CO, on the level detected. Table B shows how the CO sensor reacts to different levels of CO gas and exposure time.

Table B – Alarm indicators			
Event type	Red LED	LED icon Fire or CO	Alarm
FIRE	 every sec x 2	 Flashing	
CO Gas Level ≥ 50ppm	 every 4 sec x 2	 Flashing	 within 60-90 mins
CO Gas Level ≥ 100ppm	 every 4 sec x 3	 Flashing	 within 10-40 mins
CO Gas Level ≥ 300ppm	 every 4 sec x 4	 Flashing	 within 3 mins
Alarm triggered by interconnected Alarm	—	—	

**Note:** The Alarm may sound if cigarette smoke is blown into it, or aerosols are released nearby

 = LED on solid     = LED flashing

Pre-alarm feature: As soon as the Alarm detects 50ppm or more, the red LED will flash. This helps locate CO leaks as the Alarm gives an indication straight away.



**Note:** In an interconnected system, an Alarm triggered by another Alarm will sound but will not flash its red LED alarm indicator. This means that while the Alarm is sounding, it is not the unit actually sensing the alarm event. If you have an Ei1529RC or Ei450 Alarm Controller installed, press the locate switch to leave just the Alarm that has triggered the system sounding and identify the source and type of the alarm.

- When fire is detected, you should evacuate the residence, closing all doors and windows along the way.
- If CO is detected, you should open all windows and doors (if safe to do so), and then evacuate.

Once an Alarm detected an event and sounded, the event will be stored in the Alarm's memory.

The Alarm memory is an important feature of the Alarm where even if the house is unoccupied during an alarm condition it warns the homeowner that the Alarm has previously detected Fire or CO gas and alarmed. It is particularly useful in the case of CO leakages which may have occurred when the owner is away from the property - for example, CO leaking from a faulty boiler operating on a timer. The memory feature also helps identify the unit and event type which has previously triggered an entire alarm system, which can also very helpful after the entire alarm system has gone into alarm and then stopped, for no obvious reason.

Once the source Alarm has been identified, appropriate action can be taken e.g. In the case of a CO alarm event in memory, investigate any potential sources of CO leaks. In the case of a fire alarm event in memory, investigate the cause of nuisance / false alarms by ensuring kitchen or bathroom doors are kept closed to prevent very hot air or steam from cookers / showers reaching the sensor in the Alarm. Locate the Alarm further away from the source of steam or condensation and/or replace the Alarm if it is thought to be defective.

The memory feature has two operation modes:

- memory indication for 24 hour period after alarm.
- memory recall on demand

24-hour memory indicators: For 24 hours after alarming, the red LED alarm indicator will flash at different rates every 48 seconds (approx) depending on the alarm event type (Fire or CO) and in the case of CO, on the level detected - See Memory Mode table in section 7.

Memory recall on demand: To review the memory status at any time, press and hold the test/hush button, the red LED alarm indicator will flash in accordance to the Memory Mode table (in section 7) to convey the alarm event in memory, if any.

To Reset the Memory: Hold down the test/hush button for at least 20 seconds. Cover the Alarm with a cloth to muffle the sound during this time. Clearing of the memory is indicated by a 1-second-long flash of the red LED alarm indicator. Please note that the Alarm memory will also be reset if the Alarm is removed from its mounting plate (switched off).

## **Hush feature**

The Alarm has a combined test/hush button. When the alarm sounds, pressing the test/hush button will immediately silence the alarm for a period of 10 minutes, if due to fire, or 4 minutes, if due to CO (the red light will continue to flash). After that period of time the Alarm will reset to normal functionality. In the case of CO, the Alarm can only be silenced once during a CO incident and only if the CO level detected is < 150ppm.

Note: To stop all Alarms on an interconnected system, press the test/hush button on the Alarm sensing smoke/heat/CO (i.e. the one with the red LED alarm indicator flashing rapidly) to silence all Alarms. Pressing the test/hush button on any other Alarm will not cancel the alarm.

Alternatively, in an interconnected system fitted with a Control switch, you can identify the source Alarm by pressing the LOCATE switch. When all Alarms are sounding, it will silence all Alarms apart from the Alarm that is sensing Fire/Smoke/Heat/CO.

If the source of the alarm is due to carbon monoxide, only use the control switch in line of sight of the CO Alarm to silence it. (Note: The Ei450 can not remotely silence a CO Alarm).

**WARNING:** If your Carbon Monoxide Alarm sounds (even if you are unsure of the cause), it has detected dangerous levels of carbon monoxide. Always evacuate the dwelling.

# 4


## Testing

## 4.1 Testing and maintaining your Alarm

Frequent testing of all your Alarms is a requirement to ensure they are functioning correctly. Guidelines and best practices for testing are as follows:

1. After the system is installed.
2. Once monthly thereafter.
3. After prolonged absence from the dwelling (e.g. after holiday period).
4. After repair or servicing of any of the systems elements or household electrical works.

### Inspecting and Testing procedure

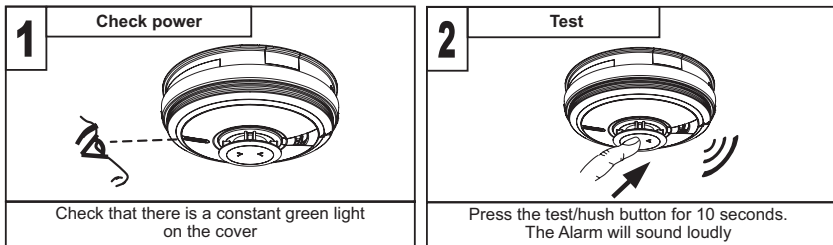

- (i) Check that the **green LED power indicator** is on continuously.
- (ii) Check also that there are no faults i.e. NO green, yellow or red LED flashing (if this is the case please see indicator summary table).

- (iii) Press the **test/hush button** for up to 10 seconds and ensure that the Alarm sounds. (**Note:** On initial press the Ei3030 will alarm the fire sound pattern. On second press the Ei3030 will alarm the CO sound pattern). This tests the sensor, electronics and sounder are working. The Alarm will stop when the button is released. (Refer to indicator summary table if you see Red or Yellow LED flashes).
- (iv) **Interconnected Alarms only** - Test the first unit by pressing the test/hush button for 10 seconds. All the Alarms should sound within 10 seconds of the first Alarm sounding. After releasing the test/hush button, the local Alarm will stop sounding immediately and the interconnected Alarms will be heard sounding in the distance for a further 3-4 seconds. This feature gives an audible verification that the interconnection is OK. Check all the other Alarms in the same way.
- (v) Check the functioning of the mains battery back-up directly after installation and then at least yearly as follows:
- Turn off the mains power at the distribution board and check that the green indicator light is now flashing (1 flash every 48 seconds) to indicate the Alarm is on backup battery power.
  - Press the test/hush button for up to 10 seconds and ensure the Alarm sounds loudly.
  - Monitor the Alarm over a 3 minute period for any fault chirps and or yellow LED fault indicator flashes (Refer to "**Fault Modes**" table on what to do if this occurs)
  - Turn the mains supply at the distribution board back on.

### **Switching off Mains for long periods**

If the premises are regularly being left without mains power for long periods the Alarms should be removed from their mounting plates and the Ei3000MRF modules (if fitted) should be removed to prevent the batteries becoming fully depleted. (This is sometimes done with holiday homes which are only occupied in the summer).

The Ei3000MRF modules (if required) must be re-fitted to the Alarms and the Alarms must be re-attached to the mounting plates when the premises are re-occupied. Ensure to match the original RF module back to the same Alarm head.



(Long term storage (over 1 year) can damage the batteries such that they will not recharge when the units are re-connected to the mains supply).

#### **DO NOT TEST WITH SMOKE, HEAT OR CO GAS.**

We do not recommend testing with smoke, heat or carbon monoxide as the results can be misleading unless special apparatus is used. However, if testing the Alarm with CO gas is required, the red LED flashing indicates the presence of CO gas as per table B.

### **4.2 Cleaning your Alarm**

Clean your Alarm regularly. In dusty areas it may be necessary to clean the Alarm more frequently.

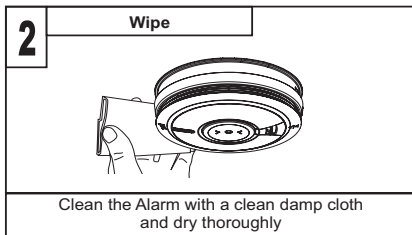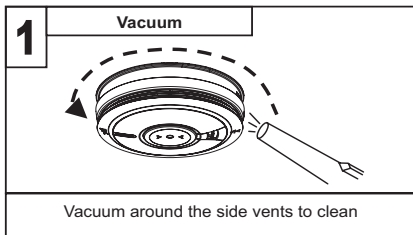

Use the narrow nozzle attachment of your vacuum cleaner to remove dust, insects and cobwebs from the sides and cover slots where the airflow enters. Clean the outside cover by occasionally wiping

with a clean damp cloth then dry thoroughly with a lint free cloth. Do not use any cleaning agents, bleaches, detergents or polishes, including those in aerosol cans.

**DO NOT PAINT YOUR ALARM.**

Other than the cleaning described above, no other customer servicing of this product is required. Servicing or repairs, when needed, must be performed by the manufacturer.

All Alarms are prone to dust and insect ingress, which can cause false alarms or failure to alarm. In certain circumstances, even with regular cleaning, contamination can build up in the sensor causing the Alarm to sound or fail. Contamination is beyond our control, it is totally unpredictable and is considered normal wear and tear. For this reason, contamination is not covered by the guarantee.



# 5

What to do in  
case of FIRE?

**WARNING:** If your Alarm sounds and you are unsure of the cause, it should be assumed that the alarm is due to an actual fire and the dwelling should be evacuated immediately.

- (i). Check room doors for heat or smoke. Do not open a hot door. Use an alternate escape route. Close all doors behind you as you leave.
- (ii). If smoke is heavy, crawl out, staying close to floor. Take short breaths, if possible, through a wet cloth or hold your breath. More people die from smoke inhalation than from flames.
- (iii). Get out as fast as you can. Do not stop for packing. Have a prearranged meeting place outside for all family members. Check everybody is there.
- (iv). Call the Fire Brigade immediately on a mobile phone or from a neighbour's house. Make sure to call the Brigade for all fires no matter how small - fires can suddenly spread. Also call the Brigade even if the alarm is automatically transmitted to a remote manned centre - the link may have failed.
- (v). **NEVER** re-enter a burning house.



# 6

What to do in case  
your Alarm detects  
Carbon Monoxide?

- (i) Open the doors and windows to ventilate the area (if it is safe to do so).
- (ii) Turn off all fuel appliances where possible.
- (iii) Evacuate the property leaving the doors and windows open.
- (iv) Get medical help immediately for anyone suffering the effects of Carbon Monoxide poisoning (headache, nausea), and advise that Carbon Monoxide poisoning is suspected.
- (v) Ring your gas or other fuel supplier on their emergency number. Keep the number in a prominent place.
- (vi) Do not re-enter the property until the alarm has stopped. (If the Alarm has been silenced by pressing the test/hush button, wait at least 5 minutes. The Alarm will then check that the CO has cleared).
- (vii) Do not use the fuel appliances again until they have been checked by an expert. In the case of gas appliances this must be a Registered Gas Installer.

The alarm will stop once the CO has cleared.

Pressing the test/hush button will silence the alarm immediately for 4min if <150ppm CO. If CO is still present after 4min, the red LED indicator and alarm will turn on again.

Note: When ventilation is provided by leaving the window and doors open, the CO build up may have dissipated by the time help arrives and the Alarm may have stopped sounding. Although your problem may appear temporarily solved, it is crucial that the source of the CO is determined and appropriate repairs made.

**NEVER IGNORE THE ALARM!**

# 7

















## Indicator Summary Tables & Troubleshooting

Normal Operation						
Mode / Action	Green LED (Power)	Yellow LED (Fault)	Red LED (Alarm)	Alarm	Icon Display FIRE/CO	Notes
Power up				—	1 Flash & FIRE CO	
Standby		—	—	—	—	
Testing (pressing and holding test/hush button)	*	—	—		Flashing	
In Alarm						
Detecting Fire		—	 as per Table B		Flashing  FIRE	Fire sound pattern
Detecting CO		—			Flashing  CO	CO sound pattern
Activated via Interconnect		—	—		—	
Pressing the test/hush button on Alarm detecting fire		—	 as per Table B	x 10mins	Flashing  FIRE	
Pressing the test/hush button on Alarm detecting CO		—		x 4 min if < 150ppm	Flashing  CO	once per alarm event
















\* With the test/hush button held the green LED will flicker/pulse every second

= LED on solid    = LED flashing

## Memory mode

What you hear / see					What type of alarm event has occurred
0-24h		>24h on button test			
Red LED	Sound	Red LED	Sound	Icon Display FIRE/CO	
 every x 2 48 secs	—	 every x 2 8 secs		Flashing  FIRE	Fire
 every x 4 48 secs	—	 every x 4 8 secs		Flashing  CO	CO Gas Level 50ppm
 every x 6 48 secs	—	 every x 6 8 secs		Flashing  CO	CO Gas Level 100ppm
 every x 8 48 secs	—	 every x 8 8 secs		Flashing  CO	CO Gas Level 300ppm

Alarm memory can be erased by pressing & holding the test/hush button for >20 seconds after which a 1-second-long flash of the red LED alarm indicator indicates memory cleared

Fault modes and Memory indicator					
What you hear / see				What it means	What to do
Green LED <sup>1</sup> (power)	Yellow LED <sup>2</sup> (fault)	Red LED (alarm)	Chirps		
 every 48 sec x1	—	—	—	AC mains off	Reconnect AC mains power
—	 every 48 sec x1	—		AC mains off Low battery backup	Reconnect AC mains power
	 every 48 sec x1	—		Low battery backup	Replace Alarm
	 every 48 sec x2	—	 x2	Sensor fault	Replace Alarm
	 every 48 sec x3	—	 x3	End of Life	Replace Alarm
	Flashes as per fault type	—	—	Fault chirps have been silenced. Rate of the yellow LED flashing indicates fault type	If required chirping can be silenced again by pressing test/hush button
	—	 when pressing test/hush button	—	There has been an alarm in your absence	Check Alarm memory section

**1** ON when AC mains power is switched on, flashes every 48s when on backup battery, OFF when both AC mains and backup battery are off.

**2** If you are unsure of the amount of flashes of the Yellow LED you can at any time while a fault condition exists, press the test/hush button. The relevant number of flashes will then be 8s apart.

**Note:** Fault chirps can be silenced by pressing the test/hush button.



The Alarm can communicate its status and history through various Led flashes and chirps/beeps. However, a more comprehensive report of all such events is available through the AudioLINK download via the smart phone App.

### **Low Battery Backup Fault**

If the battery backup supply is depleted, the sounder will give one short chirp with one yellow LED fault indicator flash every 48 seconds. In this case check that the green LED power indicator is on continuously. If it is off, or flashing every 48 seconds, the Alarm is not receiving 230V AC mains power and is being powered by the battery backup. The chirp every 48 seconds indicates that the battery is depleted. The battery is not replaceable. Check fuses, circuit breakers and wiring to determine the cause of the interruption to the mains power. If in doubt, contact a qualified electrician. Once mains power is reinstated, the chirps should cease within 2 hours as the battery charges up. If the chirping persists for over 2 hours with the green light on, there may be some other problem with the Alarm. The Alarm must be returned for repair or replacement - see **GETTING YOUR ALARM SERVICED** section.

### **Sensor Fault**

The Alarm regularly checks the optical smoke sensor, thermistor heat sensor and CO sensor for correct operation. If the Alarm has found a fault with the sensor, it will give 2 short chirps with 2 yellow LED flashes every 48 seconds. In this case, the Alarm must be returned for repair or replacement - see **GETTING YOUR ALARM SERVICED** section.

### **End of Life**

Once the Alarm passes its 10th year of installation, it will give 3 short chirps with 3 yellow LED flashes every 48 seconds to indicate it has reached its end of useful life.

The entire Alarm must be replaced (Also check the replace by date on the label on the side of the Alarm). Disconnect the mains first and replace the Alarm - see 'Removing the Alarm' section.

## Maximum Dust Compensation

The Alarm monitors the dust contamination build-up in the optical smoke chamber and then compensates for it, reducing the possibility of false alarms.

If however, the Alarm gives 4 short chirps with 4 yellow LED flashes when the test/hush button is pressed, it indicates that the Alarm has reached the maximum dust compensation. When this occurs, the Alarm will continue to operate as normal, but there is an increased risk of false alarms caused by dust contamination. If contamination has occurred quickly (e.g. due to dust from carpets being replaced) and the Alarms are sounding, the dust compensation may take some hours to operate. In this situation, remove the Alarm from the ceiling, leave it disconnected for 5 minutes, then reinstall the unit (the air must be clean i.e., dust and smoke free). The dust compensation will now operate quickly, within 60 seconds.

## Temporarily Silencing the Fault chirps

If the test/hush button is pressed on an Alarm that is giving fault chirps and yellow LED fault indicator flashes, the Alarm will be silenced (Fault Hush mode) for a period of 12 hours. However, the Alarm will sound / function as normal within that period should it detect Fire (except if the fault detected is a sensor fault). The yellow LED fault indicator will continue to flash as before to indicate the fault is still present. This is a useful feature should the fault occur at night as it keeps the disturbance at a time when people in the building are trying to sleep to a minimum. The fault chirps would return 12 hours later, which perhaps may be a more suitable time to address the fault issue with the Alarm. In case of low backup battery voltage and end of life fault chirps, this can be repeated as required.

**A sensor fault condition can only be hushed once.**

<p><b>Your Alarm does not sound when you press the test/hush button</b></p>	<ul style="list-style-type: none"> <li>• Check the Alarm is secured correctly on the mounting plate.</li> <li>• Wait 15 seconds after connecting the power before button testing.</li> <li>• Hold button down firmly for at least 10 seconds.</li> <li>• If the alarm does not sound, then your Alarm must be returned for repair or replacement - see "GETTING YOUR ALARM SERVICED" section</li> </ul>
<p><b>Your Alarm sounds for no apparent reason</b></p>	<ul style="list-style-type: none"> <li>• Follow the detailed instructions in section 5 and/or section 6 regarding the alarm condition.</li> <li>• Locate the Alarm that sounds and has a flashing red LED.</li> <li>• Identify the alarm type – Fire or CO.</li> <li>• <b>For Fire:</b> <ul style="list-style-type: none"> <li>- If you have thoroughly investigated and are sure that it is just a nuisance alarm, simply press the test/hush button briefly to silence the Alarm and any interconnected devices for 10 minutes. When the Alarm is in 'Hush' mode the red LED will continue to flash while it detects the presence of heat.</li> <li>The Alarm will reset to normal functionality at the end of the 10 minute. If additional silenced time is required, simply push the test/hush button again.</li> <li>- If you experience frequent nuisance/false alarms, it may be necessary to re-locate the Alarm away from the source of the fumes or if it continues to sound without smoke or heat being present and cleaning the Alarm does not solve the problem, it needs to be replaced.</li> </ul> </li> </ul>

- **For CO:**

- Ensure there are no fuel burning appliances in the vicinity which could be leaking CO gas (e.g. even from next door).
- Ensure there are no fumes or aerosols in the area (e.g. paint, thinners, hair spray, chemical cleaners, aerosol sprays, damp proofing done with and aqueous emulsion such as Aminofunctional siloxane and Alkylalkoxysilane) which can cause false CO alarms.
- Ensure there is no outdoor source of CO in the vicinity (e.g. a car with engine running, heavy traffic, heavy air pollution, barbecue fumes etc).
- Ensure there is no source of hydrogen such as batteries being charged (e.g. on boats or in Uninterruptable Power Supplies (UPS)), as this can lead to false CO alarms.
- Ensure there is not excessive smoke or fumes from devices such as Egyptian shisha, hookah or hubbly bubbly pipes, especially those that use coal or charcoal to heat the tobacco.
- Press the test/hush button to silence the Alarm for 4 minutes.
- If the CO Alarm continues to sound it is possibly defective and should be replaced.

<p><b>Interconnected Alarms do not all sound</b></p>	<ul style="list-style-type: none"> <li>• Hold test/hush button for 10 seconds after the first alarm has sounded to ensure signal is transmitted to all units.</li> <li>• If this is not the case and you have a hardwired interconnection, we recommend you consult a qualified electrician.</li> <li>• If the Alarm is fitted with an RF module for wireless interconnection, check that all Alarms in the RadioLINK system are powered and are house-coded correctly. (see the Ei3000MRF RadioLINK+ module manual).</li> </ul>
<p><b>Pressing the test/hush button does not silence the Alarm</b></p>	<p>Always make sure that you are pressing the test/hush button on the Alarm that sounds with the red LED flashing.</p>
<p><b>Your Alarm chirps/beeps/ flashes</b></p>	<p>In standby mode, the Alarm does not sound, beep, chirp or flash. The only light on is the green power LED.</p> <p>The Alarm automatically monitors the battery, sensor and electronics periodically to ensure that all are satisfactory. If a fault has been found, the alarm alerts the occupier to this via short chirps from its sounder and yellow LED fault indicator flashes every 48 seconds. The alarm will also indicate any faults when the test/hush button is pressed.</p> <p>See fault modes and memory indicator table.</p>

# 8

## Limitations of Fire and CO Alarms

Multi-Sensor Fire and Carbon Monoxide Alarms can significantly help to reduce the risk of fire and CO fatalities. However independent authorities have stated that these systems may be ineffective in some situations. There are a number of reasons for this:

- The Alarms will not work if the mains power supply is off or disconnected and the backup battery is depleted. Test regularly to ensure the power supply is functioning as required.
- The Alarms will not detect the danger if sufficient Smoke/Heat/CO does not reach the Alarms. Smoke/Heat/CO may be prevented from reaching the Alarm if the fire / burning fuel appliance is too far away, for example, if it is on another floor, behind a closed door, in a chimney, in a wall cavity, or if the prevailing air drafts carry the Smoke/Heat/CO away.
- The Alarms may not be heard. The sound output is loud but it may not be heard behind a closed door or if it is too far away. Interconnecting Alarms greatly improves the probability that they will be heard. The Alarm may not wake up somebody who has taken alcohol or drugs. The alarm sound may be masked by other sounds such as T.V., stereo, traffic noise etc. This Alarm is not designed for people with impaired hearing.
- The Alarms may not detect every type of fire to give sufficient early warning.
- The Alarms don't last indefinitely. The manufacturer recommends regular testing and replacement after, at most, 10 years, as a precaution.
- This Alarm is not a substitute for life insurance. House-holders are responsible for their own insurance. The Alarm warns of increasing CO levels, but we do not guarantee that this will protect everyone from CO poisoning.

- This Alarm does not detect the presence of natural gas (methane), bottled gas (propane, butane) or other combustible gases. Fit combustion gas alarms to detect these.

**Note:** This Alarm contains an electrochemical sensor which has a cross sensitivity to hydrogen. This means that they can alarm due to sensing hydrogen

**WARNING:** THIS ALARM IS DESIGNED TO PROTECT INDIVIDUALS FROM THE ACUTE EFFECTS OF CARBON MONOXIDE EXPOSURE. IT WILL NOT FULLY SAFEGUARD INDIVIDUALS WITH SPECIFIC MEDICAL CONDITIONS. IF IN DOUBT CONSULT A MEDICAL PRACTITIONER.



# 9

## Important Safeguards

When an Alarm system is installed, basic safety precautions should always be followed, including those listed below:

- Please read all instructions.
- Use the testing of the Alarm as a means to familiarise your family with the alarm sound. Rehearse emergency escape plans so everyone at home knows what to do in case the Alarm sounds. Further information can be obtained from your local fire prevention officer.
- To maintain sensitivity to Fire/CO, do not paint or cover the Alarm in any manner and; do not allow cobwebs, dust or grease to accumulate.
- If the Alarm has been damaged in any way or does not function properly, do not attempt a repair. Return the Alarm - see Section 10 '**SERVICE AND GUARANTEE**' section.
- This appliance is only intended for premises having a residential type environment.
- Alarms are not a substitute for insurance. The supplier or manufacturer is not your insurer.
- Do not dispose of your Alarm in a fire.

# 10

Service and  
Guarantee

## 10.1 Getting your Alarm serviced

If, within the guarantee period, your Alarm fails to work after you have carefully read all the instructions, checked the unit has been installed correctly, and is receiving AC power, then contact us.

If you are advised to return your Alarm, please ensure that the Alarm is placed in a padded box, not attached to the mounting plate (as the Alarm can give beeps or alarm if the test/hush button is pressed during shipping), with the proof of purchase and a note stating the nature of the fault.

## 10.2 Guarantee

Aico guarantees this Alarm for five years from the date of purchase against any defects that are due to faulty materials or workmanship. If this Alarm should become defective within the guarantee period, we shall at our discretion repair or replace the faulty unit.

This guarantee only applies to normal conditions of use and service, and does not include damage resulting from accident, neglect, misuse, unauthorised dismantling, or contamination howsoever caused. This guarantee excludes incidental and consequential damage.

This guarantee does not apply to any product that has been modified in any way by a third party or has been fitted with a third party element.

Do not interfere with the Alarm or attempt to tamper with it. This will invalidate the guarantee but more importantly may expose the user to shock or fire hazards.

This guarantee is in addition to your statutory rights as a consumer.

The crossed out wheelie bin symbol that is on your product indicates that this product should not be disposed of via the normal household waste stream. Proper disposal will prevent possible harm to the environment or to human health. When disposing of this product please separate it from other waste streams to ensure that it can be recycled in an environmentally sound manner. For more details on collection and proper disposal, please contact your local government office or the retailer where you purchased this product.





KM522831



KM83678

KM86596

EN14604: 2005 + AC 2008

BS 5446-2: 2003

EN50291-1: 2018

 2797	 0086																
Ei Electronics, Shannon, Co. Clare, Ireland 23 DoP No. 23-0001	Ei Electronics, Shannon, Co. Clare, Ireland 23 DoP No. 23-0001																
<p style="text-align: center;">EN14604:2005 + AC:2008  Smoke Alarm Devices:  Ei3030</p> <p style="text-align: center;"><b>Fire Safety</b></p> <table border="0" style="width: 100%;"> <tr> <td style="width: 40%;">Nominal activation conditions/ sensitivity, response delay (response time) and performance under fire condition</td> <td style="width: 10%; text-align: center;"><b>Pass</b></td> <td style="width: 40%;">Vibration resistance</td> <td style="width: 10%; text-align: center;"><b>Pass</b></td> </tr> <tr> <td>Operational reliability</td> <td style="text-align: center;"><b>Pass</b></td> <td>Humidity resistance</td> <td style="text-align: center;"><b>Pass</b></td> </tr> <tr> <td>Tolerance to voltage supply</td> <td style="text-align: center;"><b>Pass</b></td> <td>Corrosion resistance</td> <td style="text-align: center;"><b>Pass</b></td> </tr> <tr> <td>Response delay and temperature resistance</td> <td style="text-align: center;"><b>Pass</b></td> <td>Electrical stability</td> <td style="text-align: center;"><b>Pass</b></td> </tr> </table>		Nominal activation conditions/ sensitivity, response delay (response time) and performance under fire condition	<b>Pass</b>	Vibration resistance	<b>Pass</b>	Operational reliability	<b>Pass</b>	Humidity resistance	<b>Pass</b>	Tolerance to voltage supply	<b>Pass</b>	Corrosion resistance	<b>Pass</b>	Response delay and temperature resistance	<b>Pass</b>	Electrical stability	<b>Pass</b>
Nominal activation conditions/ sensitivity, response delay (response time) and performance under fire condition	<b>Pass</b>	Vibration resistance	<b>Pass</b>														
Operational reliability	<b>Pass</b>	Humidity resistance	<b>Pass</b>														
Tolerance to voltage supply	<b>Pass</b>	Corrosion resistance	<b>Pass</b>														
Response delay and temperature resistance	<b>Pass</b>	Electrical stability	<b>Pass</b>														

The Declaration of Performance may be consulted at [www.eielectronics.com/compliance](http://www.eielectronics.com/compliance)



An Ei Company

P/N B20665 Rev2

© Ei Electronics 2024

Aico

Oswestry, Shropshire SY10 8NR, U.K.

Tel: 01691 664100

[www.aico.co.uk](http://www.aico.co.uk)